



Kiwa Ltd.  
 Unit 5 Prime Park Way  
 Prime Enterprise Park  
 Derby  
 DE1 3QB  
 +44 (0)1332 383333  
 uk.bpenquiries@kiwa.com  
 www.kiwa.co.uk/bda

**BAW-24-321-P-A-UK**  
**BDA Agrément®**  
**Wrapsulate**  
**Spray Foam Insulation**  
**for Walls**

Elastochem Specialty Chemicals Inc.  
 37 Easton Road  
 Brantford, Ontario  
 N3P 1J4  
 Canada  
 +1 (877) 787-2436  
 info@elastochem.com  
 www.elastochem.com

**SCOPE OF AGRÉMENT**

This BDA Agrément® (hereinafter 'Agrément') relates to Wrapsulate (hereinafter the 'Product'). The Product is an in-situ formed, water-blown, spray-applied (hereinafter 'applied') thermal insulation layer which contributes to the thermal performance of external walls. The Product is for internal application on solid masonry walls or between the studs of sheathed timber- or steel-framed walls with outer masonry leaf (where masonry includes clay and calcium silicate bricks, concrete blocks, and natural and reconstituted stone block). The Product is for new and existing residential and non-residential buildings.

**DESCRIPTION**

The Product consists of two liquid-based components (hereinafter 'Product components') that are mixed under pressure and applied in-situ to form an open cell structure, semi-rigid polyurethane (hereinafter 'PUR') seamless foam insulation layer, in accordance with BS EN 14315-2, that adheres to the treated surface. The Product is applied in layers until the final required design thickness (not exceeding 400 mm) is achieved. Once applied, the Product expands, solidifies and cures.

**ILLUSTRATION**



**THIRD-PARTY ACCEPTANCE**

See Section 3.3 (Third-Party Acceptance).

**STATEMENT**

It is the opinion of Kiwa Ltd. that the Product is safe and fit for its intended use, provided it is specified, installed and used in accordance with this Agrément.

Craig Devine  
 Operations Manager, Building Products

Alpheo Mlotha CEng FIMMM MBA  
 Business Unit Manager, Building Products

## SUMMARY OF AGRÉMENT

This document provides independent information to specifiers, specialists, engineers, building control personnel, contractors, installers and other construction industry professionals who are considering the safety and fitness for purpose of the Product. This Agrément covers the following:

- Conditions of use;
- Production Control, Quality Management System and the Annual Verification Procedure;
- Product components and ancillary items, points of attention for the Specifier and examples of details;
- Installation;
- Independently assessed Product characteristics and other information;
- Compliance with national Building Regulations, other regulatory requirements and Third-Party Acceptance, as appropriate;
- Sources.

## MAJOR POINTS OF ASSESSMENT

**Moisture control** - see Section 2.2.7 - the Product:

- has a low-volume closed cell percentage;
- can contribute to limiting the risk of interstitial and surface condensation;
- is not resistant to water penetration;
- has low water vapour transmission resistance.

**Strength** - see Section 2.2.8 - the Product has adequate adhesion strength on substrates it is intended to be applied to.

**Fire performance** - see Section 2.2.9 - the Product is classified as European Classification F, in accordance with BS EN 13501-1.

**Thermal performance** - see Section 2.2.10 - the Product improves the thermal insulation of external walls and can contribute to satisfying the requirements of the national Building Regulations.

**Durability** - see Section 2.2.11 - the Product shall have a service life durability equivalent to that of the building into which it is incorporated.

**UKCA, UKNI and CE marking** - see Section 2.2.12 - the Agrément holder has responsibility for conformity marking, in accordance with all relevant British and European Product Standards.

## CONTENTS

### Section 1 - General considerations

- 1.1 - Conditions of use
- 1.2 - Production Control and Quality Management System
- 1.3 - Annual Verification Procedure - continuous surveillance

### Section 2 - Technical assessment

- 2.1 - Product components and ancillary items
- 2.2 - Points of attention to the Specifier
- 2.3 - Examples of typical details
- 2.4 - Installation
- 2.5 - Independently assessed Product characteristics

### Section 3 - CDM, national Building Regulations and Third-Party Acceptance

- 3.1 - The Construction (Design and Management) Regulations 2015 and The Construction (Design and Management) Regulations (Northern Ireland) 2016
- 3.2 - The national Building Regulations
- 3.3 - Third-Party Acceptance

### Section 4 - Sources

### Section 5 - Amendment history

### Section 6 - Conditions of use

## 1 GENERAL CONSIDERATIONS

### 1.1 CONDITIONS OF USE

#### 1.1.1 Limitations

This Agrément has been prepared in accordance with the mandatory requirements defined in the relevant Kiwa Technical Requirement. Some information in this Agrément is provided for guidance or reference purposes only; this information falls outside the scope of the Technical Requirement.

#### 1.1.2 Application

The assessment of the Product relates to its use in accordance with this Agrément and the Agrément holder's requirements.

#### 1.1.3 Assessment

Kiwa Ltd. has assessed the Product in combination with relevant test reports, technical literature, the Agrément holder's quality plan, DoPs and site visit, as appropriate.

#### 1.1.4 Installation supervision

The quality of installation and workmanship shall be controlled by a competent person who shall be an employee of an Approved Installer.

The Product shall be installed strictly in accordance with the instructions of the Agrément holder and the requirements of this Agrément.

#### 1.1.5 Geographical scope

The validity of this document is limited to England, Wales, Scotland, Northern Ireland and Ireland, with due regard to Section 3 of this Agrément (CDM, national Building Regulations and Third-Party Acceptance).

#### 1.1.6 Validity

The purpose of this Agrément is to provide well-founded confidence to apply the Product within the scope described. The validity of this Agrément is as published on [www.kiwa.co.uk/bda](http://www.kiwa.co.uk/bda).

### 1.2 PRODUCTION CONTROL AND QUALITY MANAGEMENT SYSTEM

Kiwa Ltd. has conducted an audit of the Agrément holder and determined that they fulfil all their obligations in relation to this Agrément in respect of the Product.

The initial audit demonstrated that the Agrément holder has a satisfactory Quality Management System (QMS) and is committed to continuously improving their quality plan. Document control and record-keeping procedures were deemed satisfactory. A detailed Production Quality Specification (PQS) has been compiled to ensure traceability and compliance under the terms of this Agrément.

### 1.3 ANNUAL VERIFICATION PROCEDURE - CONTINUOUS SURVEILLANCE

To demonstrate that the Product conforms with the requirements of the technical specification described in this Agrément, an Annual Verification Procedure has been agreed with the Agrément holder in respect of continuous surveillance and assessment, and auditing of the Agrément holder's QMS.

## 2 TECHNICAL ASSESSMENT

This Agrément does not constitute a design guide for the Product. It is intended only as an assessment of safety and fitness for purpose.

### 2.1 PRODUCT COMPONENTS AND ANCILLARY ITEMS

#### 2.1.1 Components included within the scope of this Agrément

The components listed in Table 1 below are integral to the Product.

Table 1 - Integral components

Product	Description
Wrapsulate	an in-situ formed, semi-rigid PUR, open cell foam insulation complying with BS EN 14315-1. It is produced by an exothermic reaction between an isocyanate component and a resin (polyol blend) component. Once sprayed and cured, it has a density ranging from 13 to 18 kg/m <sup>3</sup>

#### 2.1.2 Ancillary items falling outside the scope of this Agrément

The following ancillary items detailed in this Section may be used in conjunction with the Product, but fall outside the scope of this Agrément:

- spray machinery;
- external masonry leaf;
- breather membrane;
- timber studs;
- metal studs;
- sheathing board;
- vapour control layer (hereinafter 'VCL');
- plasterboard lining.

### 2.2 POINTS OF ATTENTION TO THE SPECIFIER

#### 2.2.1 Design

##### 2.2.1.1 Design responsibility

Project-specific design is the responsibility of an Approved Installer, trained and approved by the Agrément holder. The Specifier may be an Approved Installer.

##### 2.2.1.2 Basis of design

The characteristics detailed in the section titled 'Major Points of Assessment' shall be considered during the use of the Product.

##### 2.2.1.3 General design considerations

The Product is satisfactory for use in reducing the thermal transmittance (hereinafter 'U-value') of the external walls of new and existing residential and non-residential buildings.

A project-specific design is required. This shall be developed in close co-operation with the Agrément holder. It shall give due consideration to:

- BS EN 300;
- BS EN 351-1;
- BS EN 1992-1-1 / I.S. EN 1992-1-1;
- BS EN 1993-1-1 / I.S. EN 1993-1-1;
- BS EN 1995-1-1 / I.S. EN 1995-1-1;
- BS EN 1996-1-1 / I.S. EN 1996-1-1;
- BS EN 1996-1-2 / I.S. EN 1996-1-2;
- BS EN 1996-2 / I.S. EN 1996-2;
- BS EN 1996-3 / I.S. EN 1996-3;
- BS EN 14081-1;
- BS 5250;
- BS 8000-0;
- BS 8000-3;
- PD 6693-1;
- PD 6697.

Sheathed timber- or steel-framed walls shall:

- include a minimum nominal cavity of 50 mm width between the outer masonry leaf and the sheathed framed wall;
- incorporate cavity barriers at edges, around openings, penetrations, at junctions with roof or floor cavities and in extensive cavities with fire-resisting elements in accordance with the relevant provisions of the national Building Regulations.

Buildings incorporating the Product shall be designed and constructed to prevent moisture penetration (i.e. provision of adequate waterproofing layers) and air infiltration, in accordance with the relevant Codes and Standards.

Installation of the Product shall not be undertaken until the wall is weathertight, i.e. the roof is in place and the window and door openings, and all joints are sealed.

The substrates to which the Product is applied to and all subsequent layers up to the external wall cavity shall be vapour permeable, allowing moisture to escape from inside the building.

A suitable VCL incorporating lapped and sealed joints shall be applied behind the lining board on the warm side of the wall, unless an assessment to BS 5250 indicates that it is not necessary.

Ventilation openings shall be arranged with due consideration to potential ingress of birds and small animals, whilst also reducing the risk of blockage by other building operations.

The Product shall not be applied over electrical cables, recessed lighting, existing vents or ventilation gaps. Consider re-routing, re-laying in conduit or trunking, or de-rating electrical cables. Replace existing recessed lighting with ventilated fittings that incorporate a protective fire hood.

The Product is an open cell foam which is inert once cured and is therefore chemically inactive. The Product will not react with metals typically used in construction elements.

When the Product is sprayed between the studs of sheathed timber-framed walls (with outer masonry leaf), installation must not be carried out until the moisture content of the sheathing board and timber studs is less than 19 %.

The sheathing board shall be:

- oriented strand board (hereinafter 'OSB') type 3, manufactured in accordance with BS EN 300, with a minimum thickness of 11 mm;
- marine-grade plywood, manufactured in accordance with BS EN 313-1, with a minimum thickness of 12 mm;
- protected with a suitable breather membrane, in accordance with BS EN 13859-2.

To prevent water ingress, due consideration shall be given to the design of joint detailing at window/door openings and flue pipe penetrations in accordance with BS 6093.

Where applicable (i.e. new building), the guidance given in BRE Report 262 shall be followed in connection with the weathertightness of wall constructions. The Specifier shall select a construction appropriate to the local wind-driven rain index in accordance with BS 8104 and exposure zones in accordance with PD 6697, paying due regard to the design detailing, workmanship and materials to be used.

A suitable breather membrane incorporating lapped and sealed joints shall be placed on the outer side of the sheathing board, to avoid water penetration and allow vapours to escape from inside of the building into the external wall cavity.

Existing walls shall be in a good state of repair with no signs of rain penetration or damp. Any necessary repairs shall be carried out prior to installation

#### 2.2.1.4 Project-specific design considerations

The project-specific design shall:

- be determined by the Agrément holder;
- take into account the requirements of the relevant national Building Regulations - see Section 3.2;
- take into account the service life durability required - see Section 2.2.11.

A pre-installation survey is required to allow determination of the project-specific design - see Section 2.4.1.

The project-specific design shall ensure that the following considerations are included in the development of a project-specific design:

- structural adequacy of supporting wall;
- U-value requirements;
- condensation risk analysis requirements;
- choice of a suitable VCL and breather membrane;
- choice of a suitable plasterboard appropriate to the fire rating of the wall;
- thermal expansion effects of the supporting wall and the Product;
- design of cavity trays, weep holes, weep vents and damp-proof course;
- adequate cavity fire barriers;
- resistance to the ingress of precipitation and moisture.

Account shall be taken of Government Accredited Construction Details for Part L, England and Wales and Accredited Construction Details for Scotland (hereinafter 'Government Accredited Construction Details'), and energy efficiency measures in PAS 2030 and PAS 2035.

#### 2.2.2 Applied building physics (heat, air, moisture)

A Specialist shall check the hygrothermal behaviour of a project-specific design incorporating the Product and, if necessary, offer advice on improvements to achieve the final specification. The Specialist can be either a qualified employee of the Agrément holder or a suitably qualified consultant (in which case it is recommended that the Specialist co-operates closely with the Agrément holder).

#### 2.2.3 Permitted applications

Only applications designed according to the specifications given in this Agrément are permitted. In each case, the Specifier and Installer shall co-operate closely with the Agrément holder.

#### 2.2.4 Installer competence level

The Product shall be installed strictly in accordance with the instructions of the Agrément holder and the requirements of this Agrément.

Installation shall be by employees trained and approved by the Agrément holder and subject to inspections by Kiwa Ltd. under a Kiwa Installation Assessment & Surveillance Scheme.

### 2.2.5 Delivery, storage and site handling

The Product components are delivered in suitable packaging bearing relevant identification information (such as the Product name, production identification date or batch number, the Agrément holder's name, etc.) and, where applicable, the BDA Agrément® logo incorporating the number of this Agrément.

Prior to installation, the Product components shall be stored in accordance with the Agrément holder's requirements. Good housekeeping protocols shall be followed to avoid damage. When required, particular care shall be taken to:

- avoid exposure to direct sunlight for extended periods of time;
- avoid exposure to high or low temperatures for extended periods of time;
- store Product components in sealed drums or hermetically sealed tanks indoors at temperatures between 18 °C and 30 °C;
- store in a well-ventilated covered area to protect Product components from rain, frost and humidity;
- store away from possible ignition sources.

The isocyanate component is classified as 'harmful' under The Chemicals (Hazard Information and Packaging for Supply) Regulations 2009 (CHIP 4); drums containing Product components bear the appropriate hazard warning signs. The treated area shall be adequately ventilated after application to prevent the inhalation of isocyanate vapour. When cured, the Product is non-hazardous.

The Agrément holder has the responsibility of classifying and labelling the product under Regulation (EC) No 1272/2008 (CLP) on the Classification, packaging and labelling of chemical substances and mixtures. Installation and handling of the Product shall follow the precautions given in the relevant Safety Data Sheets.

### 2.2.6 Maintenance and repair

Once installed, the Product does not require regular maintenance, provided the weathertightness of the walls is maintained. Damaged or poorly applied Product shall be completely removed and re-applied. For advice in respect of repair and maintenance concerns, consult the Agrément holder.

### Performance factors in relation to the Major Points of Assessment

#### 2.2.7 Moisture control

##### Cell structure

The Product has a very low-volume closed cell percentage (2.42 %), in accordance with BS EN ISO 4590, and is detailed in Section 2.5.1.

##### Condensation risk

The Product has low water vapour transmission resistance, in accordance with BS EN 12086, and is detailed in Section 2.5.1.

External walls incorporating the Product can adequately limit the risk of interstitial and surface condensation when designed in accordance with BS 5250 and BRE Report 262. Room spaces shall be ventilated in accordance with BS 5250. Care shall be taken to provide adequate trickle ventilation, particularly in rooms expected to experience high humidity, and to ensure the integrity of any VCL (where installed) and lining board against vapour ingress.

The Specifier shall carry out a condensation risk analysis (CRA) at design stage on a project-specific basis, in accordance with BS 5250 and BRE Report 262, including an assessment of junctions, openings and penetrations.

##### Water absorption

The open cell structure means the Product has low resistance to water absorption by immersion, in accordance with BS EN ISO 29767, and is detailed in Section 2.5.1.

#### 2.2.8 Strength

The substrate adhesion of the Product in accordance with BS EN 1607 is detailed in Section 2.5.2.

The Specifier shall ensure that the adhesion of the Product to the substrate is sufficient. To guarantee good bonding, the substrate may be prepared prior to application in accordance with the Agrément holder's requirements.

The Product shall be protected to ensure no damage occurs when handling building materials and tools during installation or where there is risk of damage after the Product is fully cured but not yet covered.

#### 2.2.9 Fire performance

The Product is classified as European Classification F, in accordance with BS EN 13501-1.

For all building in Wales and Northern Ireland, and non-residential buildings in England, the following applies in accordance with the national Building Regulations:

- the Product shall not be used on buildings with a storey of 18 m or more above ground level. Refer to the relevant national Building Regulations for types of buildings and any exclusions that may apply;
- boundary restrictions will apply, dependent on the outermost surface materials of the external wall incorporating the Product, facing the boundary.

For residential buildings in England, the following applies in accordance with the national Building Regulations:

- the Product is restricted to buildings with no floor more than 11 m above ground level. Refer to the national Building Regulations for types of buildings and any exclusions that may apply;
- boundary restrictions will apply, dependent on the outermost surface materials of the external wall incorporating the Product, facing the boundary.

For all buildings in Scotland, the Product is not classified as 'non-combustible' and is restricted to buildings with no floor more than 11 m above ground level and not less than 1 m from the boundary. In such cases, the Product may be excluded from the unprotected area calculation, regardless of openings. Refer to the national Building Regulations for types of buildings and any exclusions that may apply.

For dwellings in Ireland, the Product shall not be used on buildings with a storey of 15 m or more above ground level; the Product can be used without any boundary restrictions. Refer to the relevant national Building Regulations for types of buildings and any exclusions that may apply.

For buildings other than dwellings in Ireland, the Product shall not be used on buildings with a storey of 18 m or more above ground level. The Product can be used without any boundary restrictions. Refer to the national Building Regulations for types of buildings and any exclusions that may apply.

The fire resistance of walls is based on the occupancy, size and use of a building and shall be a minimum of 30 minutes. It is then specified in 60-minute intervals thereafter. The Product shall be covered by a plasterboard lining fixed to studs or battens and with all joints taped, sealed and supported by studs, noggins or battens, to give a minimum 30-minute fire rating.

Walls shall be designed and constructed:

- to adequately resist the passage and penetration of fire;
- so that the unseen spread of fire and smoke with concealed spaces in a wall is inhibited.

For detailed conditions of use regarding requirements for supporting wall fire performance, cavity closers and barriers, fire stopping of service penetrations and combustibility limitations for other materials and components used in the overall wall construction, Specifiers shall refer to the relevant national Building Regulations.

The Product shall not be applied over junctions between roofs, floors and compartment walls or external walls that are required to provide a minimum period of fire resistance.

Walls shall incorporate cavity barriers at edges, junctions, around openings, service penetrations and in extensive cavities with fire-resisting elements, ensuring continuity of fire resistance, in accordance with the national Building Regulations.

The Product shall be:

- protected from naked flames and other ignition sources at all times;
- applied away from recessed lighting, and shall not be applied inside electric outlets or junction boxes.

### **Proximity of flues and appliances**

The installed Product shall be adequately separated from any chimney, heat-producing appliance or incinerator flue pipes passing through a wall. Recommended means of separation are detailed in the Approved Documents supporting the national Building Regulations.

### **2.2.10 Thermal performance**

#### **Thermal conductivity**

The U-value of a completed wall will depend on the insulation thickness, the wall structure and its coverings.

The Product can be used to upgrade a wall that has existing insulation between the studs, to meet current U-value requirements.

For the purpose of U-value calculations, and to determine if the requirements of the national Building Regulations are met, the thermal resistance and U-value of walls incorporating the Product shall be calculated according to BS EN ISO 10211 (taking into consideration BS EN ISO 6946, BS EN ISO 10456 and BRE Report 443), using the Product's declared thermal conductivity ( $\lambda_D$ ). Design and declared thermal values can be found in BS EN ISO 10456.

The requirement for limiting heat loss through the building fabric, including the effect of thermal bridging, can be satisfied if the U-value of a wall incorporating an appropriate thickness of the Product does not exceed the maximum U-values given in the national Building Regulations.

The maximum thickness of the Product shall not exceed 400 mm.

#### **Thermal bridging at junctions and around openings**

The applied Product forms a solid and seamless insulating foam layer without joints or gaps, reducing thermal bridges.

Care shall be taken in the overall design and construction to minimise air infiltration and thermal bridging at junctions with other elements and openings.

Guidance on linear thermal transmittance, heat flows and surface temperature factors can be found in the documents supporting the national Building Regulations and BS EN ISO 10211, BRE Information Paper 1/06, BRE Report 262, BRE Report 497, PAS 2030 and PAS 2035.

### **2.2.11 Durability**

The Product shall have a service life durability equivalent to that of the building into which it is incorporated. The expected lifespan of the building itself shall be at least 60 years.


Once installed, the Product is not susceptible to damage from environmental conditions normally encountered in the UK and Ireland.

### **2.2.12 UKCA, UKNI and CE marking**


The European standard for the Product is BS EN 14315-1.

## 2.3 EXAMPLES OF TYPICAL DETAILS

**Diagram 1** - Detail of typical external masonry wall (with dry-lining frame)

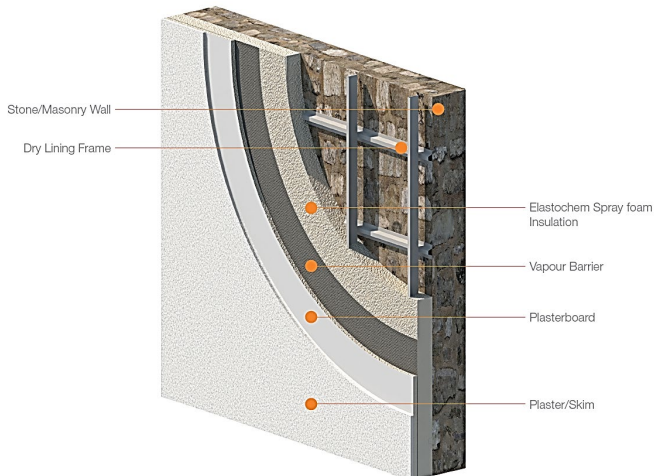

**Diagram 2** - Detail of typical external masonry wall with sheathed timber frame

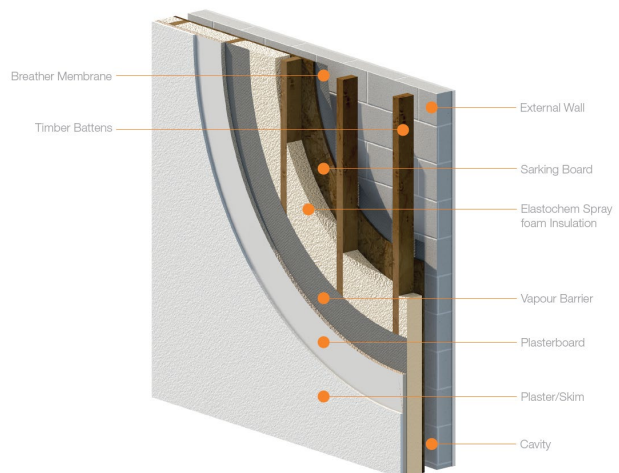

## 2.4 INSTALLATION

The Product shall be installed strictly in accordance with the instructions (hereinafter 'Installation Manual') of the Agrément holder, the requirements of this Agrément and the requirements of BS 8000-0.

### 2.4.1 Project-specific installation considerations

The project-specific design shall be determined from a pre-installation survey.

The primary requirement of the pre-installation survey is to determine the following:

- the type, suitability and condition of all wall layers and components;
- the existing wall is structurally sound, in a good state of repair with no evidence of underlying defects, rain penetration, dampness, staining or condensation;
- the location of any services, electrical devices, penetrations, and expansion joints;
- all wall elements are weathertight, the roof is in place and the window and door openings are sealed before the application of the Product;
- any ventilation requirements;
- the moisture content of porous surfaces shall not be greater than 19 %; non-porous substrates shall be checked to ensure that there is no condensation present on the surface;
- the substrate temperature is between 5 °C and 35 °C. An infrared or contact thermometer can be used for checking the substrate surface temperature;
- areas not to be treated.

### 2.4.2 Preparation

The following considerations apply before starting the work:

- application of the Product shall be carried out in accordance with BS 8000-0, BS EN 14315-1 and BS EN 14315-2;
- application of the Product may produce a build-up of harmful vapours. Installers shall wear personal protective equipment (PPE) when working with the Product, including nitrile gloves, disposable overalls and a full-face supplied-air respirator (SAR);
- sufficient natural or mechanical ventilation shall be put in place to prevent gasses entering other potentially habited areas of the building. It is advisable that other trades and personnel avoid entering the work area during and immediately after application;
- the relative humidity of the environment shall be considered before application. Care shall be taken to ensure that moisture vapour ingress from other areas of the building is restricted;
- the ambient temperature during the spraying shall be between 5 to 35 °C;
- safety equipment, services, task lighting and ventilation facilities shall be easily accessible;
- building access and safe re-entry times shall be in accordance with Agrément holder's guidelines;
- during application, prohibit contact with open flames and other sources of ignition;
- the maximum thickness of the Product shall not exceed 400 mm.

The following works shall be undertaken before installing the Product:

- substrate preparation and application parameters shall be in accordance with Product Installation Manual;
- any timber elements shall be treated and repaired if required;
- all permanent elements (i.e. windows, doors, walls and surfaces), air vents, pipes and other service penetrations shall be protected to prevent blockage and splashing of the Product;
- services, e.g. electrical cables, may need re-routing or trunking;
- flues shall be isolated by applying non-combustible thermal insulation material around them;
- ensure that the component's mixing ratio is correct (1:1 by volume), by separately measuring the flow rates of the two components before they pass through the spraying machine;
- ensure that all parameters (i.e. pressures and temperatures) of the components and spray machinery are in line with the Agrément holder's Installation guidelines;
- carry out the following quality control tests, using test methods in accordance with BS EN 14315-1 and BS EN 14315-2 to check:
  - the appearance of the Product, ensuring a round spray pattern, no sticky patches, no light or dark patches, no voids and a consistent colour;



- the reaction profile of the Product by spraying a small section of material onto the floor and measuring the cream time, gel time, tack-free time and free-rise density, while ensuring the Product is free of moisture content and lumps or bubbles in the texture;
- the adhesion strength to the substrate by conducting an on-site pull-out test;
- if the material shows any issue during quality control tests, adjust the parameters of the spray machinery and repeat the process until the required result is achieved.

### 2.4.3 Outline installation procedure

Detailed installation procedures can be found in the Agrément holder's Installation Manual.

The outline procedure is as follows:

General:

- set the appropriate temperature and pressure parameters on the spray machinery and select a suitable spraying nozzle;
- prepare and mix the Product components with an electric or pneumatic mixer to the required mixing ratio;
- apply the Product with the spray gun perpendicular to the substrate;
- ensure any subsequent layer is sprayed immediately after the previous one has fully risen.

Sheathed timber- or steel-framed walls:

- spray the Product between the studs, starting from the base of the wall;
- spray the Product in layers to the required total thickness (50 mm to 150 mm thick per layer), with a gradual build-up following the same process.

Solid masonry walls:

- create studwork frame with 600 mm centres in accordance with the Agrément holder's Installation Manual;
- spray the Product between the studs created, starting from the base of the wall;
- spray the Product in layers to the required total thickness (50 mm to 150 mm thick per layer), with a gradual build-up following the same process.

### 2.4.4 Finishing

The following finishing is required on completion of the installation:

- the Product shall be cured and cold prior to undertaking any finishing work;
- any excess Product can be trimmed flat using a handsaw;
- install a VCL and plasterboard lining as required;
- follow the post-application best practices according to 'Guidance on best practices for installation of spray polyurethane foam';
- a survey shall be performed to check that electrical cables and flues are not obstructed. Corrective measures shall be taken to clear any such obstruction.

## 2.5 INDEPENDENTLY ASSESSED PRODUCT CHARACTERISTICS

### 2.5.1 Moisture control

Test	Standard	Result
Closed cell volume	BS EN ISO 4590 Method 2b	CCC1 (2.42 % closed cells)
Water vapour diffusion factor ( $\mu$ )	BS EN 12086 Method A	2.71
Water vapour diffusion equivalent air layer thickness ( $S_d$ )		0.19 m
Short-term water absorption	BS EN ISO 29767 Method B	0.2 kg/m <sup>2</sup>

### 2.5.2 Strength

Test	Standard	Result	
Adhesion strength perpendicular to faces	BS EN 1607	on concrete	147 kPa
		on OSB	111 kPa
		on natural stone	74 kPa
		on steel	27 kPa

### 2.5.3 Fire performance

Test	Standard	Result
Reaction to fire	BS EN 13501-1	F

### 2.5.4 Thermal performance

Test	Standard	Result	
Declared aged thermal conductivity ( $\lambda_D$ )	50 to 400 mm thick	BS EN 12667	0.036 W/mK

### 2.5.5 Other properties

Test	Standard	Result	
Dimensional stability under specified conditions	BS EN 1604	70 °C and 90 % RH	DS(TH)4
		-20 °C	
Airflow resistance	BS EN ISO 9053-1	505 x 10 <sup>3</sup> Pa.s.m <sup>-1</sup>	

REACH Statement for the Product in respect of emission of dangerous substances in accordance with Regulation (EC) No 1907/2006 confirms that no hazardous materials are present.

**3.1 THE CONSTRUCTION (DESIGN AND MANAGEMENT) REGULATIONS 2015 AND THE CONSTRUCTION (DESIGN AND MANAGEMENT) REGULATIONS (NORTHERN IRELAND) 2016**

Information in this Agrément may assist the client, principal designer/CDM co-ordinator, designer and contractors to address their obligations under these Regulations.

**3.2 THE NATIONAL BUILDING REGULATIONS**

In the opinion of Kiwa Ltd., the Product, if installed and used in accordance with Section 2 of this Agrément, can satisfy or contribute to satisfying the relevant requirements of the following national Building Regulations.

This Agrément shall not be construed to confer the compliance of any project-specific design with the national Building Regulations.

**3.2.1 England****The Building Regulations 2010 and subsequent amendments**

- B3(4) Internal fire spread (Structure) - the Product can inhibit the unseen spread of fire and smoke within concealed spaces
- C2(c) Resistance to moisture - a wall incorporating the Product can adequately protect a building from interstitial and surface condensation
- L1(a)(i) Conservation of fuel and power - the Product can limit heat gains and losses through a wall
- Regulation 7(1) Materials and workmanship - the Product is manufactured from suitably safe and durable materials for its application and can be installed to give a satisfactory performance
- Regulation 23 Requirements relating to thermal elements - the Product can contribute to a wall complying with the requirements of L1(a)(i)
- Regulation 26 CO<sub>2</sub> emission rates for new buildings - the Product can contribute to a building not exceeding its target CO<sub>2</sub> emission rate
- Regulation 26A Fabric energy efficiency rates for new buildings - the Product can contribute to satisfying this Regulation
- Regulation 26C Target primary energy rates for new buildings - the Product can contribute to satisfying this Regulation

**3.2.2 Wales****The Building Regulations 2010 and subsequent amendments**

- B3(4) Internal fire spread (Structure) - the Product can inhibit the unseen spread of fire and smoke within concealed spaces
- C2(c) Resistance to moisture - a wall incorporating the Product can adequately protect a building from interstitial and surface condensation
- L1(a)(i) Conservation of fuel and power - the Product can limit heat gains and losses through a wall
- Regulation 7(1) Materials and workmanship - the Product is manufactured from suitably safe and durable materials for its application and can be installed to give a satisfactory performance
- Regulation 23 Requirements relating to thermal elements - the Product can contribute to a wall complying with the requirements of L1(a)(i)
- Regulation 26 CO<sub>2</sub> emission rates for new buildings - the Product can contribute to a building not exceeding its target CO<sub>2</sub> emission rate
- Regulation 26A Primary energy rates for new buildings - the Product can contribute to satisfying this Regulation
- Regulation 26B Fabric performance values for new dwellings - the Product can contribute to satisfying this Regulation

**3.2.3 Scotland****The Building (Scotland) Regulations 2004 and subsequent amendments****3.2.3.1 Regulation 8(1) Durability, workmanship and fitness of materials**

- The Product is manufactured from acceptable materials and is adequately resistant to deterioration and wear under normal service conditions, provided it is installed in accordance with the requirements of this Agrément

**3.2.3.2 Regulation 9 Building standards - Construction**

- 2.4 Cavities - the Product can inhibit the unseen spread of fire and smoke within concealed spaces
- 3.15 Condensation - a wall incorporating the Product can protect a building from moisture caused by surface or interstitial condensation
- 6.2 Building insulation envelope - the Product will contribute to the insulation envelope resisting thermal transfer
- 7.1(a)(b) Statement of sustainability - the Product can contribute to satisfying the relevant Requirements of Regulation 9, Sections 1 to 6, and therefore will contribute to a construction meeting a bronze level of sustainability, as defined in this Standard; in addition, the Product can contribute to a construction meeting a higher level of sustainability, as defined in this Standard

**3.2.3.3 Regulation 12 Building standards - Conversions**

- All comments given under Regulation 9 also apply to this Regulation, with reference to Schedule 6 of The Building (Scotland) Regulations 2004 and subsequent amendments, clause 0.12 of the Technical Handbook (Domestic) and clause 0.12 of the Technical Handbook (Non-Domestic)

**3.2.4 Northern Ireland****The Building Regulations (Northern Ireland) 2012 and subsequent amendments**

- 23(1) Fitness of materials and workmanship - the Product is suitable and can be adequately mixed, prepared and applied
- 29 Condensation - walls incorporating the Product can adequately protect a building from moisture in the form of interstitial condensation
- 35(4) Internal fire spread (Structure) - the Product can inhibit the unseen spread of fire and smoke within concealed spaces
- 39(a)(i) Conservation measures - the Product will limit heat gains and losses through a wall
- 40(2) Target carbon dioxide emission rate - the Product will contribute to a building not exceeding its target CO<sub>2</sub> emission rate
- 43 Renovation of thermal elements - the Product can contribute to a wall complying with the requirements of 39(a)(i)

### 3.2.5 Ireland

#### Building Regulations 1997 and subsequent amendments

In order to demonstrate compliance with Irish Building Regulations, this BDA Agrément® certifies that the Product complies with the requirements of a recognised document and indicates it is suitable for its intended purpose and use.

- B3(3) Internal fire spread (structure, for buildings other than dwellings) - the Product can inhibit the unseen spread of fire and smoke within concealed spaces
- B8(3) Internal fire spread (structure, for dwellings) - the Product can inhibit the unseen spread of fire and smoke within concealed spaces
- C4 Resistance to weather and ground moisture - a wall incorporating the Product can contribute to adequately protecting a building from the passage of moisture from precipitation and condensation
- D1 Materials and workmanship - the Product is manufactured from suitably safe and durable materials for the application and can be installed to give a satisfactory performance
- L1 Conservation of fuel and energy - the Product can enable a building to conserve energy and limit CO<sub>2</sub> emissions
- L2(a) Conservation of fuel and energy (for existing dwellings) - the Product will limit heat gains and losses through a wall
- L4(a) Conservation of fuel and energy (for existing buildings other than dwellings) - the Product will limit heat gains and losses through a wall
- L5(c) Conservation of fuel and energy (for new buildings other than dwellings) - the Product will limit heat gains and losses through a wall
- Regulation 8(c) Conservation of fuel and energy (for new dwellings) - the Product can contribute to satisfying this Requirement

## 3.3 THIRD-PARTY ACCEPTANCE

In the opinion of Kiwa Ltd. if installed, used, and maintained in accordance with this Agrément, this Product can satisfy the appropriate structural, fire, moisture, thermal and durability requirements of a Structural Warranty provider. Please contact the relevant Structural Warranty provider to ascertain their project specific design requirements and to confirm their acceptance on a case-by-case basis.

- BS EN ISO 4590:2016 Rigid cellular plastics. Determination of the volume percentage of open cells and of closed cells
- BS EN ISO 6946:2017 Building components and building elements. Thermal resistance and thermal transmittance. Calculation methods
- BS EN ISO 9001:2015 Quality management systems. Requirements
- BS EN ISO 9053-1:2018 Acoustics. Determination of airflow resistance. Static airflow method
- BS EN ISO 10211:2017 Thermal bridges in building construction. Heat flows and surface temperatures. Detailed calculations
- BS EN ISO 10456:2007 Building materials and products. Hygrothermal properties. Tabulated design values and procedures for determining declared and design thermal values
- BS EN ISO 29767:2019 Thermal insulating products for building applications. Determination of short-term water absorption by partial immersion
- BS EN 300:2006 Oriented strand boards (OSB). Definitions, classification and specifications
- BS EN 313-1:1996 Plywood. Classification and terminology - Plywood. Classification and terminology. Classification
- BS EN 351-1:2023 Durability of wood and wood-based products. Preservative-treated solid wood. Classification of preservative penetration and retention
- BS EN 1604:2013 Thermal insulating products for building applications. Determination of dimensional stability under specified temperature and humidity conditions
- BS EN 1607:2013 Thermal insulating products for building applications. Determination of tensile strength perpendicular to faces
- BS EN 1992-1-1:2004+A1:2014 Eurocode 2: Design of concrete structures. General rules and rules for buildings
- NA+A2:2014 to BS EN 1992-1-1:2004+A1:2014 UK National Annex to Eurocode 2. Design of concrete structures. General rules and rules for buildings
- BS EN 1993-1-1:2005+A1:2014 Eurocode 3. Design of steel structures. General rules and rules for buildings
- NA+A1:2014 to BS EN 1993-1-1:2005+A1:2014 UK National Annex to Eurocode 3. Design of steel structures. General rules and rules for buildings
- BS EN 1995-1-1:2004+A2:2014 Eurocode 5: Design of timber structures. General. Common rules and rules for buildings
- NA to BS EN 1995-1-1:2004+A2:2014 UK National Annex to Eurocode 5: Design of timber structures. General. Common rules and rules for buildings
- BS EN 1996-1-1:2005+A1:2012 Eurocode 6. Design of masonry structures - General rules for reinforced and unreinforced masonry structures
- NA to BS EN 1996-1-1:2005+A1:2012 UK National Annex to Eurocode 6. Design of masonry structures. General rules for reinforced and unreinforced masonry structures
- BS EN 1996-1-2:2005 Eurocode 6. Design of masonry structures - General rules. Structural fire design
- NA to BS EN 1996-1-2:2005 UK National Annex to Eurocode 6. Design of masonry structures. General rules. Structural fire design
- BS EN 1996-2:2006 Eurocode 6. Design of masonry structures - Design considerations, selection of materials and execution of masonry
- NA to BS EN 1996-2:2006 UK National Annex to Eurocode 6. Design of masonry structures. Design considerations, selection of materials and execution of masonry
- BS EN 1996-3:2006 Eurocode 6. Design of masonry structures - Simplified calculation methods for unreinforced masonry structures
- NA+A1:2014 to BS EN 1996-3:2006 UK National Annex to Eurocode 6. Design of masonry structures. Simplified calculation methods for unreinforced masonry structures
- BS EN 12086:2013 Thermal insulating products for building applications. Determination of water vapour transmission properties
- BS EN 12667:2001 Thermal performance of building materials and products. Determination of thermal resistance by means of guarded hot plate and heat flow meter methods. Products of high and medium thermal resistance
- BS EN 13501-1:2018 Fire classification of construction products and building elements. Classification using data from reaction to fire tests
- BS EN 13859-2:2014 Flexible sheets for waterproofing. Definitions and characteristics of underlays - Underlays for walls
- BS EN 14081-1:2016+A1:2019 Timber structures. Strength graded structural timber with rectangular cross section - General requirements
- BS EN 14315-1:2013 Thermal insulating products for buildings. In-situ formed sprayed rigid polyurethane (PUR) and polyisocyanurate (PIR) foam products. Specification for the rigid foam spray system before installation
- BS EN 14315-2:2013 Thermal insulating products for buildings. In-situ formed sprayed rigid polyurethane (PUR) and polyisocyanurate (PIR) foam products. Specification for the installed insulation products
- BS 5250:2021 Management of moisture in buildings. Code of practice
- BS 6093:2006+A1:2013 Design of joints and jointing in building construction. Guide
- BS 8000-0:2014+A1:2024 Workmanship on construction sites. Introduction and general principles
- BS 8000-3:2020 Workmanship on construction sites - Masonry. Code of practice
- BS 8104:1992 Code of practice for assessing exposure of walls to wind-driven rain
- American Chemistry Council Spray Foam Coalition:2012 Guidance on best practices for the installation of spray polyurethane foam
- BRE Information Paper 1/06:2006 Assessing the effects of thermal bridging at junctions and around openings
- BRE Report 262:2002 Thermal insulation: avoiding risks
- BRE Report 443:2019 Conventions for U-value calculations
- BRE Report 497:2016 Conventions for calculating linear thermal transmittance and temperature factors
- I.S. EN 1992-1-1:2004+AC:2010+A1:2014 Eurocode 2: Design of concrete structures. Part 1-1: General rules and rules for buildings
- I.S. EN 1992-1-1/NA:2004/NA:2010/AC2:2020 Irish National Annex to Eurocode 2: Design of concrete structures. Part 1-1: General rules and rules for buildings
- I.S. EN 1993-1-1:2005 Eurocode 3: Design of steel structures - Part 1-1: General rules and rules for buildings
- I.S. EN 1993-1-1/NA:2005 Irish National Annex to Eurocode 3: Design of steel structures - Part 1-1: General rules and rules for buildings
- I.S. EN 1995-1-1:2005 Eurocode 5: Design of timber structures. Part 1-1: General. Common rules and rules for buildings
- I.S. EN 1995-1-1/NA:2005+A1:2013 Irish National Annex to Eurocode 5: Design of timber structures. Part 1-1: General. Common rules and rules for buildings
- I.S. EN 1996-1-1:2005+A1:2012 Eurocode 6: Design of masonry structures. Part 1-1: General rules for reinforced and unreinforced masonry structures
- I.S. EN 1996-1-1+A1:2012/NA:2010+A1:2014 Irish National Annex to Eurocode 6: Design of masonry structures. Part 1-1: General rules for reinforced and unreinforced masonry structures
- I.S. EN 1996-1-2:2005 Eurocode 6: Design of masonry structures. Part 1-2: General rules. Structural fire design
- I.S. EN 1996-1-2/NA:2005 Irish National Annex to Eurocode 6: Design of masonry structures. Part 1-2: General rules. Structural fire design
- I.S. EN 1996-2:2006 Eurocode 6: Design of masonry structures. Part 2: Design considerations, selection of materials and execution of masonry
- I.S. EN 1996-2/NA:2006 Irish National Annex to Eurocode 6: Design of masonry structures. Part 2: Design considerations, selection of materials and execution of masonry

- I.S. EN 1996-3:2006 Eurocode 6: Design of masonry structures. Part 3: Simplified calculation methods for unreinforced masonry structures
- I.S. EN 1996-3/NA:2006 Irish National Annex to Eurocode 6: Design of masonry structures. Part 3: Simplified calculation methods for unreinforced masonry structures
- PAS 2030:2023 Installation of energy efficiency measures in existing dwellings. Specification
- PAS 2035:2023 Retrofitting dwellings for improved energy efficiency. Specification and guidance
- PD 6693-1:2019 Recommendations for the design of timber structures to Eurocode 5: Design of timber structures - General. Common rules and rules for building
- PD 6697:2019 Recommendations for the design of masonry structures to BS EN 1996-1-1 and BS EN 1996-2
- Regulation (EC) No 1272/2008: Classification, labelling and packaging of substances and mixtures
- Regulation (EC) No 1907/2006: Registration, Evaluation, Authorisation and Restriction of Chemicals (REACH)
- UK Statutory Instruments 2009 No. 716 The Chemicals (Hazard Information and Packaging for Supply) Regulations 2009

**Remark** - Apart from these sources, technical information and confidential reports have been assessed; any relevant documents are in the possession of Kiwa Ltd. and are kept in the Technical Assessment File of this Agrément. The Installation Manual for the Product may be subject to change; contact the Agrément holder for the clarification of revisions.

## 5 AMENDMENT HISTORY

Revision	Amendment description	Author	Approver	Date
-	First issue	A Chapman	C Devine	January 2025

## 6 CONDITIONS OF USE

This Agrément may only be reproduced and distributed in its entirety.

Where a National Annex exists in respect of a BS EN (or other) standard, its use is deemed mandatory wherever the original standard is referenced.

Kiwa Ltd. has used due skill, care and attention in the preparation of this BDA Agrément®.

Whilst all due diligence has been used, no liability or warranty is extended by Kiwa Ltd.

The Agrément holder is responsible for advising Kiwa Ltd. immediately if there is a variation to the Product specification or constituent elements/components after initial publication of this BDA Agrément®.

For full terms and conditions, refer to Kiwa Ltd.